## SIEMENS

## Data sheet

## 3RT2025-1AK64-3MA0



power contactor, AC-3e/AC-3, 17 A, 7.5 kW / 400 V, 3-pole, 110 V AC, 50 Hz / 120 V, 60 Hz, auxiliary contacts: 2 NO + 2 NC, screw terminal, size: S0, captive auxiliary switch, no surge suppressor retrofittable

product brand name	SIRIUS		
product designation	Power contactor		
product type designation	3RT2		
General technical data			
size of contactor	SO		
product extension			
<ul> <li>function module for communication</li> </ul>	No		
auxiliary switch	No		
power loss [W] for rated value of the current			
<ul> <li>at AC in hot operating state</li> </ul>	1.8 W		
<ul> <li>at AC in hot operating state per pole</li> </ul>	0.6 W		
<ul> <li>without load current share typical</li> </ul>	7.9 W		
insulation voltage			
<ul> <li>of main circuit with degree of pollution 3 rated value</li> </ul>	690 V		
<ul> <li>of auxiliary circuit with degree of pollution 3 rated value</li> </ul>	690 V		
surge voltage resistance			
<ul> <li>of main circuit rated value</li> </ul>	6 kV		
<ul> <li>of auxiliary circuit rated value</li> </ul>	6 kV		
maximum permissible voltage for protective separation between coil and main contacts according to EN 60947-1	400 V		
shock resistance at rectangular impulse			
• at AC	7,5g / 5 ms, 4,7g / 10 ms		
shock resistance with sine pulse			
• at AC	11,8g / 5 ms, 7,4g / 10 ms		
mechanical service life (operating cycles)			
<ul> <li>of contactor typical</li> </ul>	10 000 000		
<ul> <li>of the contactor with added electronically optimized auxiliary switch block typical</li> </ul>	5 000 000		
<ul> <li>of the contactor with added auxiliary switch block typical</li> </ul>	10 000 000		
reference code according to IEC 81346-2	Q		
Substance Prohibitance (Date)	10/01/2009		
Ambient conditions			
installation altitude at height above sea level maximum	2 000 m		
ambient temperature			
during operation	-25 +60 °C		
during storage	-55 +80 °C		
relative humidity minimum	10 %		
relative humidity at 55 °C according to IEC 60068-2-30 maximum	95 %		
Main circuit			
number of poles for main current circuit	3		

number of NO contacts for main contacts	3
operating voltage	
at AC-3 rated value maximum	690 V
<ul> <li>at AC-3e rated value maximum</li> </ul>	690 V
operational current	
<ul> <li>at AC-1 at 400 V at ambient temperature 40 °C rated</li> </ul>	40 A
value	
• at AC-1	
— up to 690 V at ambient temperature 40 °C rated value	40 A
— up to 690 V at ambient temperature 60 °C rated	35 A
value	
• at AC-3	
— at 400 V rated value	17 A
— at 500 V rated value	17 A
— at 690 V rated value	13 A
• at AC-3e	
— at 400 V rated value	17 A
— at 500 V rated value	17 A
— at 690 V rated value	13 A
• at AC-4 at 400 V rated value	15.5 A
at AC-5a up to 690 V rated value	35.2 A
• at AC-5b up to 400 V rated value	14.1 A
• at AC-6a	
— up to 230 V for current peak value n=20 rated value	11.4 A
— up to 400 V for current peak value n=20 rated value	11.4 A
— up to 500 V for current peak value n=20 rated value	11.4 A
<ul> <li>up to 690 V for current peak value n=20 rated value</li> <li>at AC-6a</li> </ul>	11.3 A
	7.6 A
<ul> <li>— up to 230 V for current peak value n=30 rated value</li> <li>— up to 400 V for current peak value n=30 rated value</li> </ul>	7.6 A
— up to 500 V for current peak value n=30 rated value	7.6 A
— up to 690 V for current peak value n=30 rated value	7.6 A
minimum cross-section in main circuit at maximum AC-1 rated	10 mm <sup>2</sup>
value	
operational current for approx. 200000 operating cycles at AC-4	
at 400 V rated value	7.7 A
at 690 V rated value	7.7 A
operational current	
• at 1 current path at DC-1	
— at 24 V rated value	35 A
— at 60 V rated value	20 A
— at 110 V rated value	4.5 A
— at 220 V rated value	1 A
— at 440 V rated value	0.4 A
— at 600 V rated value	0.25 A
• with 2 current paths in series at DC-1	
— at 24 V rated value	35 A
— at 60 V rated value	35 A
— at 110 V rated value	35 A
— at 220 V rated value	5 A
— at 440 V rated value	1 A
— at 600 V rated value	0.8 A
<ul> <li>with 3 current paths in series at DC-1</li> </ul>	
— at 24 V rated value	35 A
— at 60 V rated value	35 A
— at 110 V rated value	35 A
— at 220 V rated value	35 A
— at 440 V rated value	2.9 A
— at 600 V rated value	1.4 A
<ul> <li>at 1 current path at DC-3 at DC-5</li> </ul>	

— at 24 V rated value	20 A				
— at 60 V rated value	5 A				
— at 220 V rated value	1 A				
— at 440 V rated value	0.09 A				
— at 600 V rated value	0.06 A				
<ul> <li>with 2 current paths in series at DC-3 at DC-5</li> </ul>					
— at 24 V rated value	35 A				
— at 60 V rated value	35 A				
— at 110 V rated value	15 A				
— at 220 V rated value	3 A				
— at 440 V rated value	0.27 A				
— at 600 V rated value	0.16 A				
<ul> <li>with 3 current paths in series at DC-3 at DC-5</li> </ul>					
— at 24 V rated value	35 A				
— at 60 V rated value	35 A				
— at 110 V rated value	35 A				
— at 220 V rated value	10 A				
— at 440 V rated value	0.6 A				
— at 600 V rated value	0.6 A				
	0.07				
<ul> <li>operating power</li> <li>at AC-2 at 400 V rated value</li> </ul>	7.5 kW				
	7.0 NVV				
• at AC-3	4 1344				
— at 230 V rated value	4 kW				
— at 400 V rated value	7.5 kW				
— at 500 V rated value	7.5 kW				
— at 690 V rated value	11 kW				
• at AC-3e					
— at 230 V rated value	4 kW				
— at 400 V rated value	4.5 kW				
— at 500 V rated value	7.5 kW				
— at 690 V rated value	11 kW				
operating power for approx. 200000 operating cycles at AC-					
4					
• at 400 V rated value	3.5 kW				
<ul> <li>at 690 V rated value</li> </ul>	6 kW				
operating apparent power at AC-6a					
• up to 230 V for current peak value n=20 rated value	4.5 kVA				
	7.8 kVA				
• up to 230 V for current peak value n=20 rated value					
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> </ul>	7.8 kVA				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> </ul>	7.8 kVA 9.9 kVA				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> </ul>	7.8 kVA 9.9 kVA				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> </ul>	7.8 kVA 9.9 kVA 13.6 kVA				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> </ul> Operating apparent power at AC-6a <ul> <li>up to 230 V for current peak value n=30 rated value</li> </ul>	7.8 kVA 9.9 kVA 13.6 kVA 3 kVA				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> </ul>	7.8 kVA 9.9 kVA 13.6 kVA 3 kVA 5.2 kVA				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> </ul>	7.8 kVA 9.9 kVA 13.6 kVA 3 kVA 5.2 kVA 6.6 kVA				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> </ul>	7.8 kVA 9.9 kVA 13.6 kVA 3 kVA 5.2 kVA 6.6 kVA 9.1 kVA				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> </ul>	7.8 kVA 9.9 kVA 13.6 kVA 3 kVA 5.2 kVA 6.6 kVA 9.1 kVA 225 A; Use minimum cross-section acc. to AC-1 rated value				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> </ul>	7.8 kVA 9.9 kVA 13.6 kVA 3 kVA 5.2 kVA 6.6 kVA 9.1 kVA 225 A; Use minimum cross-section acc. to AC-1 rated value 225 A; Use minimum cross-section acc. to AC-1 rated value				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> </ul>	<ul> <li>7.8 kVA</li> <li>9.9 kVA</li> <li>13.6 kVA</li> <li>3 kVA</li> <li>5.2 kVA</li> <li>6.6 kVA</li> <li>9.1 kVA</li> </ul> 225 A; Use minimum cross-section acc. to AC-1 rated value 225 A; Use minimum cross-section acc. to AC-1 rated value 189 A; Use minimum cross-section acc. to AC-1 rated value				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> </ul>	7.8 kVA 9.9 kVA 13.6 kVA 3 kVA 5.2 kVA 6.6 kVA 9.1 kVA 225 A; Use minimum cross-section acc. to AC-1 rated value 225 A; Use minimum cross-section acc. to AC-1 rated value				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> </ul>	<ul> <li>7.8 kVA</li> <li>9.9 kVA</li> <li>13.6 kVA</li> <li>3 kVA</li> <li>5.2 kVA</li> <li>6.6 kVA</li> <li>9.1 kVA</li> </ul> 225 A; Use minimum cross-section acc. to AC-1 rated value 225 A; Use minimum cross-section acc. to AC-1 rated value 189 A; Use minimum cross-section acc. to AC-1 rated value				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> </ul>	<ul> <li>7.8 kVA</li> <li>9.9 kVA</li> <li>13.6 kVA</li> <li>3 kVA</li> <li>5.2 kVA</li> <li>6.6 kVA</li> <li>9.1 kVA</li> </ul> 225 A; Use minimum cross-section acc. to AC-1 rated value 225 A; Use minimum cross-section acc. to AC-1 rated value 189 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for switching at zero current maximum</li> <li>limited to 1 s switching at zero current maximum</li> <li>limited to 10 s switching at zero current maximum</li> <li>limited to 30 s switching at zero current maximum</li> <li>limited to 60 s switching at zero current maximum</li> </ul>	<ul> <li>7.8 kVA</li> <li>9.9 kVA</li> <li>13.6 kVA</li> <li>3 kVA</li> <li>5.2 kVA</li> <li>6.6 kVA</li> <li>9.1 kVA</li> </ul> 225 A; Use minimum cross-section acc. to AC-1 rated value 225 A; Use minimum cross-section acc. to AC-1 rated value 189 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for surrent peak value n=30 rated value</li> <li>up to 690 V for surrent peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for surrent peak value n=30 rated value</li> <li>up to 690 V for surrent peak value n=30 rated value</li> <li>up to 690 V for surrent peak value n=30 rated value</li> <li>up to 500 V for surrent peak value n=30 rated value</li> <li>up to 500 V for surrent peak value n=30 rated value</li> <li>up to 690 V for surrent peak value n=30 rated value</li> <li>up to 690 V for surrent peak value n=30 rated value</li> <li>up to 690 V for surrent peak value n=30 rated value</li> <li>up to 690 V for surrent peak value n=30 rated value</li> <li>up to 690 v for surrent peak value n=30 rated value</li> <li>up to 690 v for surrent peak value n=30 rated value</li> <li>up to 690 v for surrent peak value n=30 rated value</li> <li>up to 690 v for surrent peak value n=30 rated value</li> <li>up to 690 v for surrent peak value n=30 rated value</li> <li>up to 690 v for surrent peak value n=30 rated value</li> <li>up to 690 v for surrent peak value n=30 rated value</li> <li>up to 690 v for surrent peak value n=30 rated value n=30 rated value</li> <li>up to 690 v for surrent p</li></ul>	<ul> <li>7.8 kVA</li> <li>9.9 kVA</li> <li>13.6 kVA</li> <li>3 kVA</li> <li>5.2 kVA</li> <li>6.6 kVA</li> <li>9.1 kVA</li> </ul> 225 A; Use minimum cross-section acc. to AC-1 rated value 225 A; Use minimum cross-section acc. to AC-1 rated value 189 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>short-time withstand current in cold operating state up to 40 °C</li> <li>limited to 1 s switching at zero current maximum</li> <li>limited to 30 s switching at zero current maximum</li> <li>limited to 60 s switching at zero current maximum</li> <li>limited to 60 s switching at zero current maximum</li> <li>at AC</li> </ul>	<ul> <li>7.8 kVA</li> <li>9.9 kVA</li> <li>13.6 kVA</li> <li>3 kVA</li> <li>5.2 kVA</li> <li>6.6 kVA</li> <li>9.1 kVA</li> </ul> 225 A; Use minimum cross-section acc. to AC-1 rated value 225 A; Use minimum cross-section acc. to AC-1 rated value 189 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V so current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V so current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V so current peak value n=30 rated value</li> <li>up to 690 V so current peak value n=30 rated value</li> <li>short-time withstand current in cold operating state up to 40 °C</li> <li>limited to 1 s switching at zero current maximum</li> <li>limited to 30 s switching at zero current maximum</li> <li>limited to 60 s switching at zero current maximum</li> <li>limited to 60 s switching at zero current maximum</li> <li>at AC</li> <li>operating frequency</li> <li>at AC</li> </ul>	<ul> <li>7.8 kVA</li> <li>9.9 kVA</li> <li>13.6 kVA</li> <li>3 kVA</li> <li>5.2 kVA</li> <li>6.6 kVA</li> <li>9.1 kVA</li> </ul> 225 A; Use minimum cross-section acc. to AC-1 rated value 225 A; Use minimum cross-section acc. to AC-1 rated value 189 A; Use minimum cross-section acc. to AC-1 rated value 189 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 115 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>short-time withstand current in cold operating state up to 40 °C</li> <li>limited to 1 s switching at zero current maximum</li> <li>limited to 30 s switching at zero current maximum</li> <li>limited to 60 s switching at zero current maximum</li> <li>limited to 60 s switching at zero current maximum</li> <li>at AC</li> <li>operating frequency</li> <li>at AC-1 maximum</li> </ul>	<ul> <li>7.8 kVA</li> <li>9.9 kVA</li> <li>13.6 kVA</li> <li>3 kVA</li> <li>5.2 kVA</li> <li>6.6 kVA</li> <li>9.1 kVA</li> </ul> 225 A; Use minimum cross-section acc. to AC-1 rated value 225 A; Use minimum cross-section acc. to AC-1 rated value 189 A; Use minimum cross-section acc. to AC-1 rated value 189 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 15 A; Use minimum cross-section acc. to AC-1 rated value 15 000 1/h 1 000 1/h				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>to 600 V for current peak value n=30 rated value</li> <li>a AC ocurrent maximum</li> <li>at AC-1 maximum</li> <li>at AC-2 maximum</li> </ul>	<ul> <li>7.8 kVA</li> <li>9.9 kVA</li> <li>13.6 kVA</li> <li>3 kVA</li> <li>5.2 kVA</li> <li>6.6 kVA</li> <li>9.1 kVA</li> </ul> 225 A; Use minimum cross-section acc. to AC-1 rated value 225 A; Use minimum cross-section acc. to AC-1 rated value 189 A; Use minimum cross-section acc. to AC-1 rated value 189 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 15 A; Use minimum cross-section acc. to AC-1 rated value 100 1/h 1 000 1/h				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>operating apparent power at AC-6a</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>to 690 V for current peak value n=30 rated value</li> <li>to 690 V for current peak value n=30 rated value</li> <li>to 690 V for current peak value n=30 rated value</li> <li>to 690 V for current peak value n=30 rated value<td>7.8 kVA 9.9 kVA 13.6 kVA 3 kVA 5.2 kVA 6.6 kVA 9.1 kVA 225 A; Use minimum cross-section acc. to AC-1 rated value 225 A; Use minimum cross-section acc. to AC-1 rated value 189 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 15 A; Use minimum cross-section acc. to AC-1 rated value 1000 1/h 1 000 1/h 1 000 1/h</td></li></ul>	7.8 kVA 9.9 kVA 13.6 kVA 3 kVA 5.2 kVA 6.6 kVA 9.1 kVA 225 A; Use minimum cross-section acc. to AC-1 rated value 225 A; Use minimum cross-section acc. to AC-1 rated value 189 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 15 A; Use minimum cross-section acc. to AC-1 rated value 1000 1/h 1 000 1/h 1 000 1/h				
<ul> <li>up to 230 V for current peak value n=20 rated value</li> <li>up to 400 V for current peak value n=20 rated value</li> <li>up to 500 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=20 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 230 V for current peak value n=30 rated value</li> <li>up to 400 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 500 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>up to 690 V for current peak value n=30 rated value</li> <li>limited to 1 s switching at zero current maximum</li> <li>limited to 30 s switching at zero current maximum</li> <li>limited to 60 s switching at zero current maximum</li> <li>at AC-1 maximum</li> <li>at AC-</li></ul>	<ul> <li>7.8 kVA</li> <li>9.9 kVA</li> <li>13.6 kVA</li> <li>3 kVA</li> <li>5.2 kVA</li> <li>6.6 kVA</li> <li>9.1 kVA</li> </ul> 225 A; Use minimum cross-section acc. to AC-1 rated value 225 A; Use minimum cross-section acc. to AC-1 rated value 189 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 140 A; Use minimum cross-section acc. to AC-1 rated value 15 A; Use minimum cross-section acc. to AC-1 rated value 1000 1/h 1 000 1/h				


type of voltage of the control supply voltage	AC
control supply voltage at AC	
• at 50 Hz rated value	110 V
• at 60 Hz rated value	120 V
operating range factor control supply voltage rated value of magnet coil at AC	
• at 50 Hz	0.8 1.1
• at 60 Hz	0.8 1.1
apparent pick-up power of magnet coil at AC	
• at 50 Hz	68 VA
• at 60 Hz	67 VA
inductive power factor with closing power of the coil	
• at 50 Hz	0.72
• at 60 Hz	0.74
apparent holding power of magnet coil at AC	
• at 50 Hz	7.9 VA
• at 60 Hz	6.5 VA
inductive power factor with the holding power of the coil	
• at 50 Hz	0.25
• at 60 Hz	0.28
closing delay	
• at AC	8 40 ms
opening delay	
• at AC	4 16 ms
arcing time	10 10 ms
control version of the switch operating mechanism	Standard A1 - A2
Auxiliary circuit	
number of NC contacts for auxiliary contacts instantaneous	2
contact	
number of NO contacts for auxiliary contacts instantaneous contact	2
operational current at AC-12 maximum	10 A
operational current at AC-15	
• at 230 V rated value	6 A
• at 400 V rated value	3 A
• at 500 V rated value	2 A
at 690 V rated value	1 A
operational current at DC 12	
operational current at DC-12	
• at 24 V rated value	10 A
-	10 A 6 A
<ul> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> </ul>	6 A 6 A
<ul> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> </ul>	6 A 6 A 3 A
<ul> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 125 V rated value</li> </ul>	6 A 6 A 3 A 2 A
<ul> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 125 V rated value</li> <li>at 220 V rated value</li> </ul>	6 A 6 A 3 A 2 A 1 A
<ul> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 125 V rated value</li> <li>at 220 V rated value</li> <li>at 600 V rated value</li> </ul>	6 A 6 A 3 A 2 A
<ul> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 125 V rated value</li> <li>at 220 V rated value</li> <li>at 600 V rated value</li> <li>operational current at DC-13</li> </ul>	6 A 6 A 3 A 2 A 1 A
<ul> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 125 V rated value</li> <li>at 220 V rated value</li> <li>at 600 V rated value</li> </ul>	6 A 6 A 3 A 2 A 1 A
<ul> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 125 V rated value</li> <li>at 220 V rated value</li> <li>at 600 V rated value</li> <li>operational current at DC-13</li> </ul>	6 A 6 A 3 A 2 A 1 A 0.15 A
<ul> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 125 V rated value</li> <li>at 220 V rated value</li> <li>at 600 V rated value</li> <li>at 600 V rated value</li> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> </ul>	6 A 6 A 3 A 2 A 1 A 0.15 A 6 A 2 A 2 A
<ul> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 125 V rated value</li> <li>at 220 V rated value</li> <li>at 600 V rated value</li> <li>operational current at DC-13</li> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 60 V rated value</li> <li>at 60 V rated value</li> <li>at 40 V rated value</li> <li>at 60 V rated value</li> </ul>	6 A 6 A 3 A 2 A 1 A 0.15 A 6 A 2 A
<ul> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 125 V rated value</li> <li>at 220 V rated value</li> <li>at 600 V rated value</li> <li>at 600 V rated value</li> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> </ul>	6 A 6 A 3 A 2 A 1 A 0.15 A 6 A 2 A 2 A 2 A 1 A 0.9 A
<ul> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 125 V rated value</li> <li>at 220 V rated value</li> <li>at 600 V rated value</li> <li>operational current at DC-13</li> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 60 V rated value</li> <li>at 60 V rated value</li> <li>at 40 V rated value</li> <li>at 60 V rated value</li> </ul>	6 A 6 A 3 A 2 A 1 A 0.15 A 6 A 2 A 2 A 2 A 1 A
<ul> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 125 V rated value</li> <li>at 220 V rated value</li> <li>at 600 V rated value</li> </ul> <b>operational current at DC-13</b> <ul> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 125 V rated value</li> </ul>	6 A 6 A 3 A 2 A 1 A 0.15 A 6 A 2 A 2 A 2 A 1 A 0.9 A
<ul> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 125 V rated value</li> <li>at 220 V rated value</li> <li>at 600 V rated value</li> <li>at 600 V rated value</li> <li>at 48 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 220 V rated value</li> <li>at 60 V rated value</li> <li>at 60 V rated value</li> <li>at 125 V rated value</li> <li>at 125 V rated value</li> <li>at 125 V rated value</li> <li>at 220 V rated value</li> <li>at 600 V rated value</li> </ul>	6 A 6 A 3 A 2 A 1 A 0.15 A 6 A 2 A 2 A 2 A 1 A 0.9 A 0.3 A
<ul> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 125 V rated value</li> <li>at 220 V rated value</li> <li>at 600 V rated value</li> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 220 V rated value</li> <li>at 24 V rated value</li> <li>at 25 V rated value</li> <li>at 110 V rated value</li> <li>at 220 V rated value</li> <li>at 220 V rated value</li> <li>at 600 V rated value</li> </ul>	6 A 6 A 3 A 2 A 1 A 0.15 A 6 A 2 A 2 A 2 A 1 A 0.9 A 0.3 A 0.1 A
<ul> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 125 V rated value</li> <li>at 220 V rated value</li> <li>at 600 V rated value</li> <li>at 600 V rated value</li> <li>at 48 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 220 V rated value</li> <li>at 60 V rated value</li> <li>at 60 V rated value</li> <li>at 125 V rated value</li> <li>at 125 V rated value</li> <li>at 125 V rated value</li> <li>at 220 V rated value</li> <li>at 600 V rated value</li> </ul>	6 A 6 A 3 A 2 A 1 A 0.15 A 6 A 2 A 2 A 2 A 1 A 0.9 A 0.3 A 0.1 A
<ul> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 125 V rated value</li> <li>at 220 V rated value</li> <li>at 600 V rated value</li> <li>at 600 V rated value</li> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 110 V rated value</li> <li>at 110 V rated value</li> <li>at 220 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 125 V rated value</li> <li>at 125 V rated value</li> <li>at 220 V rated value</li> <li>at 20 V</li></ul>	6 A 6 A 3 A 2 A 1 A 0.15 A 6 A 2 A 2 A 2 A 1 A 0.9 A 0.3 A 0.1 A
<ul> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 125 V rated value</li> <li>at 220 V rated value</li> <li>at 600 V rated value</li> <li>operational current at DC-13</li> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 48 V rated value</li> <li>at 110 V rated value</li> <li>at 110 V rated value</li> <li>at 220 V rated value</li> <li>at 600 V rated value</li> <li>at 600 V rated value</li> <li>at 125 V rated value</li> <li>at 600 V rated value</li></ul>	6 A 6 A 3 A 2 A 1 A 0.15 A 6 A 2 A 2 A 2 A 1 A 0.9 A 0.3 A 0.1 A 1 faulty switching per 100 million (17 V, 1 mA)
<ul> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 125 V rated value</li> <li>at 220 V rated value</li> <li>at 600 V rated value</li> <li>at 600 V rated value</li> <li>at 24 V rated value</li> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 125 V rated value</li> <li>at 420 V rated value</li> <li>at 480 V rated value</li> <li>at 480 V rated value</li> </ul>	6 A 6 A 3 A 2 A 1 A 0.15 A 6 A 2 A 2 A 2 A 1 A 0.9 A 0.3 A 0.1 A 1 faulty switching per 100 million (17 V, 1 mA) 14 A
<ul> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 125 V rated value</li> <li>at 220 V rated value</li> <li>at 220 V rated value</li> <li>at 600 V rated value</li> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 220 V rated value</li> <li>at 60 V rated value</li> <li>at 60 V rated value</li> <li>at 125 V rated value</li> <li>at 125 V rated value</li> <li>at 125 V rated value</li> <li>at 220 V rated value</li> <li>at 600 V rated value</li> <li>at 600 V rated value</li> <li>at 600 V rated value</li> <li>at 480 V rated value</li> <li>at 480 V rated value</li> <li>at 600 V rated value</li> </ul>	6 A 6 A 3 A 2 A 1 A 0.15 A 6 A 2 A 2 A 2 A 1 A 0.9 A 0.3 A 0.1 A 1 faulty switching per 100 million (17 V, 1 mA) 14 A
<ul> <li>at 24 V rated value</li> <li>at 48 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 125 V rated value</li> <li>at 220 V rated value</li> <li>at 600 V rated value</li> <li>at 600 V rated value</li> <li>at 24 V rated value</li> <li>at 60 V rated value</li> <li>at 60 V rated value</li> <li>at 60 V rated value</li> <li>at 110 V rated value</li> <li>at 125 V rated value</li> <li>at 60 V rated value</li> <li>at 60 V rated value</li> <li>at 125 V rated value</li> <li>at 10 V rated value</li> <li>at 125 V rated value</li> <li>at 220 V rated value</li> <li>at 220 V rated value</li> <li>at 220 V rated value</li> <li>at 600 V rated value</li> </ul>	6 A 6 A 3 A 2 A 1 A 0.15 A 6 A 2 A 2 A 2 A 1 A 0.9 A 0.3 A 0.1 A 1 faulty switching per 100 million (17 V, 1 mA) 14 A


— at 230 V rated value	3 hp			
• for 3-phase AC motor				
— at 200/208 V rated value	3 hp			
— at 220/230 V rated value	5 hp			
— at 460/480 V rated value	10 hp			
— at 575/600 V rated value	15 hp			
contact rating of auxiliary contacts according to UL	A600 / Q600			
Short-circuit protection				
design of the fuse link				
<ul> <li>for short-circuit protection of the main circuit</li> </ul>				
<ul> <li>— with type of coordination 1 required</li> </ul>	gG: 63A (690V,100kA), aM: 32A (690V,100kA), BS88: 63A (415V,80kA)			
<ul> <li>— with type of assignment 2 required</li> </ul>	gG: 25A (690V,100kA), aM: 20A (690V,100kA), BS88: 25A (415V,80kA)			
<ul> <li>for short-circuit protection of the auxiliary switch required</li> </ul>	gG: 10 A (500 V, 1 kA)			
Installation/ mounting/ dimensions				
mounting position	+/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface			
fastening method	screw and snap-on mounting onto 35 mm DIN rail according to DIN EN 60715			
<ul> <li>side-by-side mounting</li> </ul>	Yes			
height	85 mm			
width	45 mm			
depth	141 mm			
required spacing				
<ul> <li>with side-by-side mounting</li> </ul>				
— forwards	10 mm			
— upwards	10 mm			
— downwards	10 mm			
— at the side	0 mm			
<ul> <li>for grounded parts</li> </ul>				
— forwards	10 mm			
— upwards	10 mm			
— at the side	6 mm			
— downwards	10 mm			
<ul> <li>for live parts</li> </ul>				
— forwards	10 mm			
— upwards	10 mm			
— downwards	10 mm			
— at the side	6 mm			
Connections/ Terminals				
type of electrical connection				
for main current circuit	screw-type terminals			
<ul> <li>for auxiliary and control circuit</li> </ul>	screw-type terminals			
<ul> <li>at contactor for auxiliary contacts</li> </ul>	Screw-type terminals			
<ul> <li>of magnet coil</li> </ul>	Screw-type terminals			
type of connectable conductor cross-sections for main contacts				
• solid	2x (1 2.5 mm²), 2x (2.5 10 mm²)			
solid or stranded	2x (1 2.5 mm²), 2x (2.5 10 mm²)			
<ul> <li>finely stranded with core end processing</li> </ul>	2x (1 2.5 mm²), 2x (2.5 6 mm²), 1x 10 mm²			
connectable conductor cross-section for main contacts				
• solid	1 10 mm²			
stranded	1 10 mm²			
<ul> <li>finely stranded with core end processing</li> </ul>	1 10 mm²			
connectable conductor cross-section for auxiliary contacts				
solid or stranded	0.5 2.5 mm²			
<ul> <li>finely stranded with core end processing</li> </ul>	0.5 2.5 mm²			
type of connectable conductor cross-sections				
<ul> <li>for auxiliary contacts</li> </ul>				
— solid or stranded	2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²)			
<ul> <li>— finely stranded with core end processing</li> </ul>	2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²)			
<ul> <li>for AWG cables for auxiliary contacts</li> </ul>	2x (20 16), 2x (18 14)			
AWG number as coded connectable conductor cross				
section				


<ul> <li>for main contact</li> </ul>	to		16 9				
<ul> <li>for auxiliary con</li> </ul>		16 8 20 14					
Safety related data			20 11				
product function							
•	ccording to IEC 60947-4-1		Yes				
positively driven operation according to IEC 60947-5-1		No					
B10 value with high demand rate according to SN 31920		450 000					
proportion of danger							
with low demand rate according to SN 31920		40 %					
	0		73 %				
			100 FIT				
			20 a				
61508		200					
protection class IP o	n the front according to I	EC 60529	IP20				
touch protection on	the front according to IEC	60529	finger-safe, for verti	ical contact from th	e front		
suitability for use							
<ul> <li>safety-related s</li> </ul>	0		Yes				
Certificates/ approvals	<u> </u>						
General Product Ap	proval						
		<u>Confirmation</u>			<u>KC</u>	EHC	
EMC	Functional Safety/Safety of Ma- chinery	Declaration of	Conformity	Test	Certificates	Marine / Shipping	
RCM	Type Examination Cer- tificate	UK CA	EG-Ko	E ate	be Test Certific- es/Test Report	ABS	
Marine / Shipping						other	
BUREAU VERITAS		Hoyd's Register urs	RINA		KMRS RARS	<u>Confirmation</u>	
other		Railway	Environme	nt			
UDE VDE	<u>Confirmation</u>	<u>Vibration and S</u>	nock <u>Environmer</u> firmati				
	d to exit the Russian mark						
Siemens is working Please contact your lo	on the renewal of the curr ical Siemens office on the s other than the sanctioned E	ent EAC certifica tatus of validity of	tes. the EAC certification		port or offer to sup	oply these products to an	
Information- and Down https://www.siemens.co Industry Mall (Online	<u>y.siemens.com/cs/ww/en/vi</u> wnloadcenter (Catalogs, E <u>com/ic10</u> e ordering system)	Brochures,)					
https://support.industry Information- and Dow https://www.siemens.co Industry Mall (Online https://mall.industry.sie Cax online generator http://support.automatt Service&Support (Ma	y.siemens.com/cs/ww/en/vi wnloadcenter (Catalogs, E com/ic10 e ordering system) emens.com/mall/en/en/Cata r ion.siemens.com/WW/CAX anuals, Certificates, Chara	Brochures,) alog/product?mlfb= order/default.aspx acteristics, FAQs,	?lang=en&mlfb=3RT2 )		1		
https://support.industry Information- and Dow https://www.siemens.cc Industry Mall (Online https://mall.industry.sii Cax online generator http://support.automat Service&Support (Ma https://support.industry	y.siemens.com/cs/ww/en/vi wnloadcenter (Catalogs, E com/ic10 e ordering system) emens.com/mall/en/en/Cata r ion.siemens.com/WW/CAX anuals, Certificates, Chara y.siemens.com/cs/ww/en/ps	Brochures,) alog/product?mlfb= order/default.aspx acteristics, FAQs, s/3RT2025-1AK64	?lang=en&mlfb=3RT2 ) - <u>3MA0</u>	2025-1AK64-3MA0	-		
https://support.industry Information- and Dow https://www.siemens.co Industry Mall (Online https://mall.industry.sii Cax online generator http://support.automat Service&Support (Ma https://support.industry	y.siemens.com/cs/ww/en/vi wnloadcenter (Catalogs, E com/ic10 e ordering system) emens.com/mall/en/en/Cata r ion.siemens.com/WW/CAX anuals, Certificates, Chara y.siemens.com/cs/ww/en/ps duct images, 2D dimensio	Brochures,) alog/product?mlfb= order/default.aspx acteristics, FAQs, s/3RT2025-1AK64	?lang=en&mlfb=3RT2 ) - <u>3MA0</u>	2025-1AK64-3MA0	AN macros,)	change without notice	


7/10/2023


Subject to change without notice © Copyright Siemens http://www.automation.siemens.com/bilddb/cax\_de.aspx?mlfb=3RT2025-1AK64-3MA0&lang=en Characteristic: Tripping characteristics, I<sup>2</sup>t, Let-through current https://support.industry.siemens.com/cs/ww/en/ps/3RT2025-1AK64-3MA0/char Further characteristics (e.g. electrical endurance, switching frequency) http://www.automation.siemens.com/bilddb/index.aspx?view=Search&mlfb=3RT2025-1AK64-3MA0&objecttype=14&gridview=view1







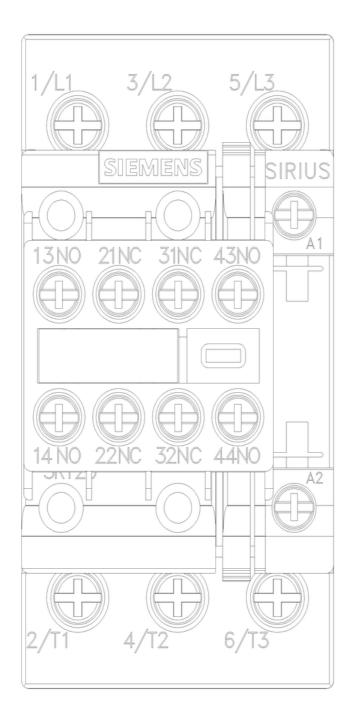

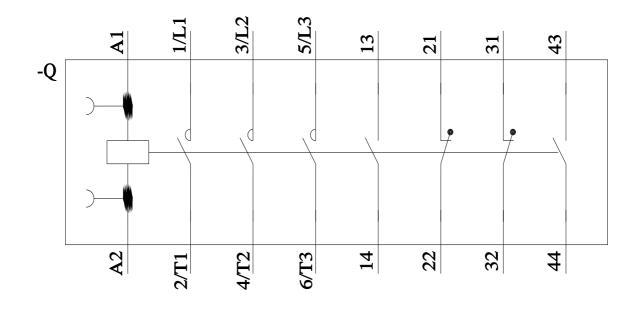

last modified:

2/10/2023 🖸