

# PVC

## Three Phase Voltage Relay




- 10 Amp Relay
- 1NO and SPDT
- Undervoltage
- Phase Loss (Single Phase)
- Phase Imbalance
- Phase Rotation
- Pick-up & Drop-out Delays
- Normal Condition LED



### Operation

The PVC's output contacts energize when:

1. All the phases are present;
2. The voltages are within 10% of the setting;
3. The phases are in the proper rotation
4. The phases are balanced;
5. The frequency is within tolerance. Built into the PVC is a 5 second pick-up delay to allow the three phase line to stabilize. If any of these conditions shift beyond the setpoints, the output contact will de-energize after a 5 second time delay. Single phase conditions will be detected when the voltage in one phase is 5% different from the voltages in the other two phases (Phase Imbalance).

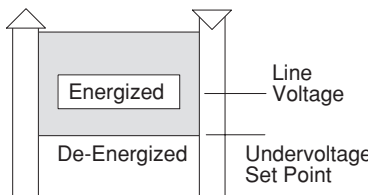

### Specifications

#### Electrical

**Line Voltage:**  
110VAC to 600VAC, 3Ø

**Frequency:** 60Hz, 300 Series 50Hz

**Line Voltage Ranges:**  
100 Series - 110VAC to 120VAC, 3Ø  
200 Series - 208VAC to 240VAC, 3Ø  
300 Series - 380VAC to 415VAC, 3Ø  
400 Series - 440VAC to 480VAC, 3Ø  
600 Series - 575VAC to 600VAC, 3Ø

**Maximum Overtoltage:**  
10% of highest nominal voltage

**Maximum Frequency Shift:** 0.1Hz

**Undervoltage:** 10% below set point

**Phase Imbalance:** 5% typical

**Phase Rotation:** A - B - C

**Phase Loss:**  
Complete loss to 95% of nominal

**Time Delays:**  
Pick-up: 5 Sec. Fixed  
Drop-out: 5 Sec. Fixed

**Power Consumption:** 16VA

**Output Contacts:**  
10 Amps @ 240VAC  
2 Amps @ 600VAC  
100,000 Full Load Electrical Cycles  
10,000,000 Mechanical Cycles

#### Physical

**Mounting:** Surface

**Termination:** Screw Terminals


**Packaging:** Dust Cover

**Weight:** 8 Oz. Approx.

#### Ambient Temperatures

**Operating:** -20°C to 40°C  
**Storage:** -20°C to 85°C

### Ordering Information

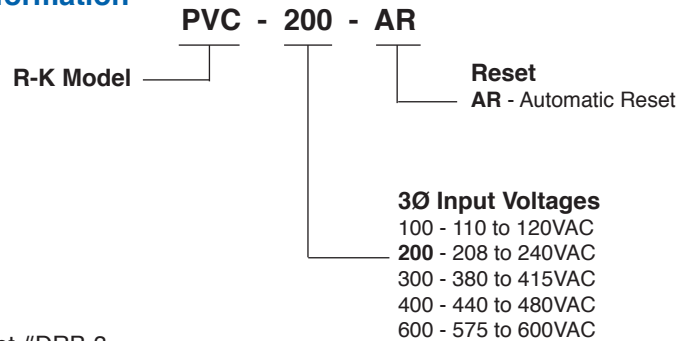


DIN Rail Bracket #DRB-3

### Connections

The PVC should be connected to the line voltage on the load side on the last line fuse before the motor and on the line side of the starter (MS).

M = Motor MS = Motor Starter  
Fuses = ≤1 amp (optional)  
OL = Overloads

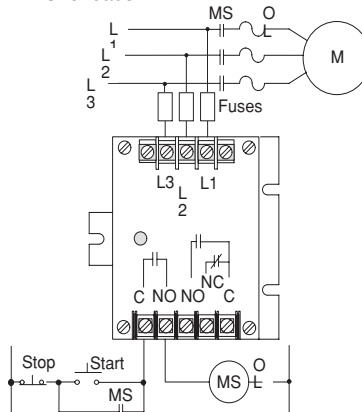

### Dimensions

